
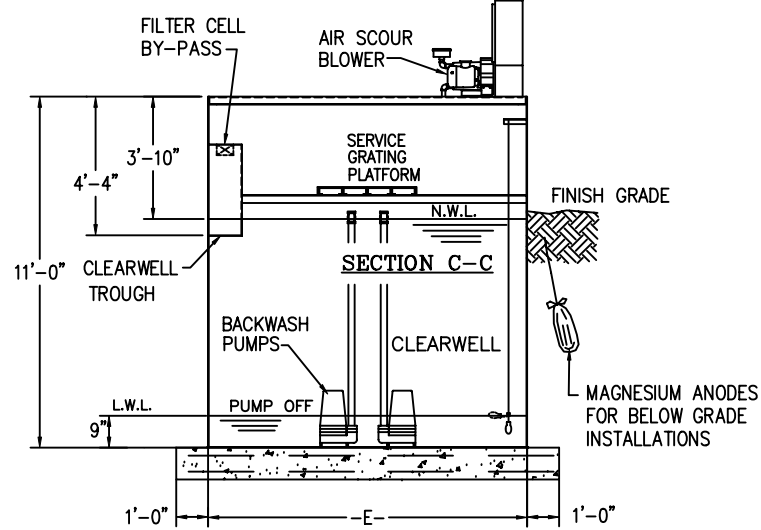
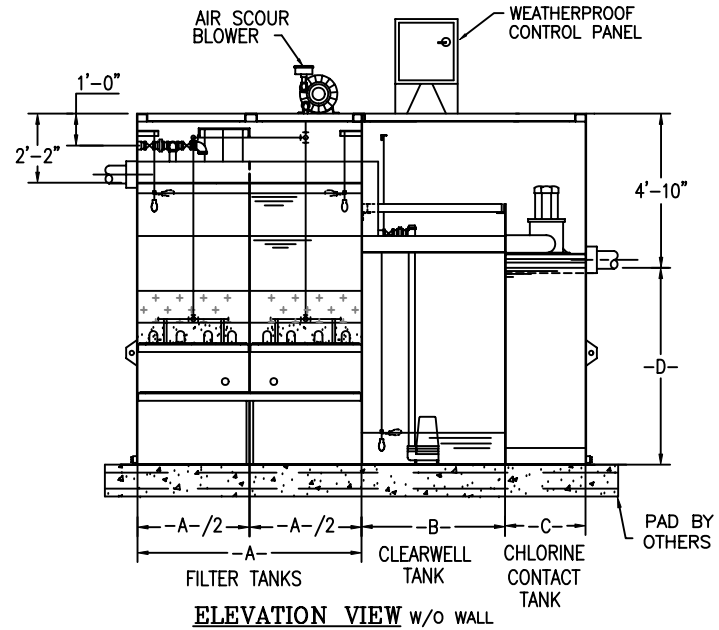
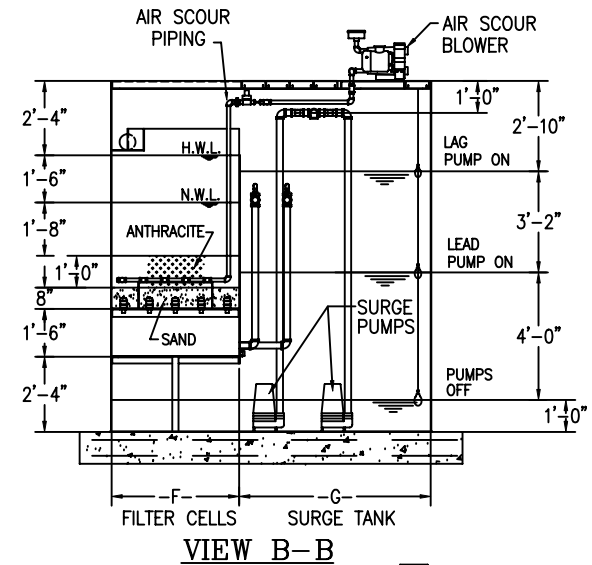


NOTES:

- 1.) ALL EXTERNAL TANK PIPING IS NOT SUPPLIED BY PCS
- 2.) ACCESS LADDERS AND HANDRAILS ARE OPTIONAL
- 3.) INCOMING ELECTRICAL POWER SUPPLY AND THE CONNECTION TO THE CONTROL PANEL IS BY OTHERS.
- 4.) FOUNDATION PAD DESIGN IS DETERMINED BY THE PROJECT ENGINEER AFTER PROJECT SITE SOIL ANALYSIS IS COMPLETED

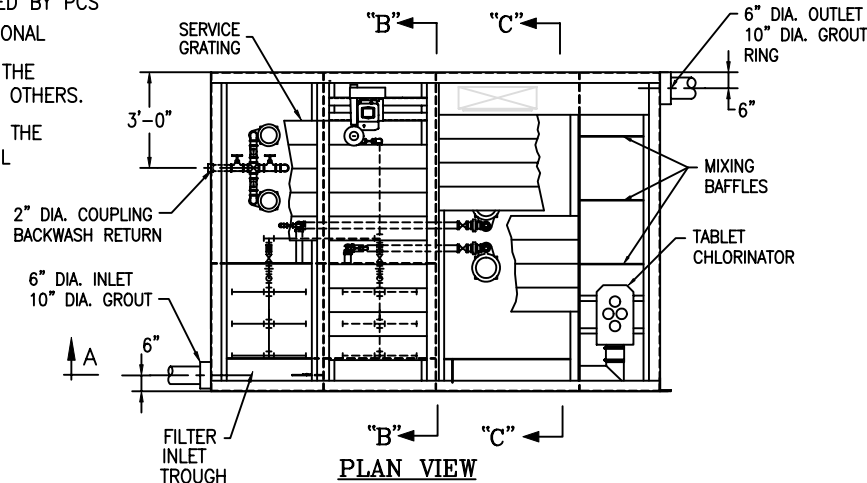

DESIGN FLOW: MAXIMUM _____ GPD

OPTIONAL EQUIPMENT- MATERIALS -TANKAGE	
FULL TANK GRATING	GALVANIZED PIPING
BAR TYPE GRATING	DE-CHLORINATION
HANDRAILS/ TOEPLATES	GAS CHLORINATION
LADDERS/ STAIRWAYS	U V DISINFECTION
ANCHOR BRK'TS	NEMA 4X PANEL
MAGNESIUM ANODES	REMOTE MOUNTED BLOWERS & CONTROLS
EPOXY PAINT SYSTEM	

TERTIARY FILTER MODEL NO.	AREA IN SQ. FT.		CHAMBER VOLUME IN GAL.		
	FILTER CELL NO. 1	FILTER CELL NO. 2	CLEARWELL	SURGE	CHLORINE CONTACT
TF-2- C					

PCS Pollution Control Systems, Inc.
 5827 Happy Hollow Ln, Suite 1B
 Milford, Ohio 45150
 (513) 831-1165
 E-mail PolConSys@aol.com

PREFABRICATED TERTIARY FILTER SYSTEM			
SCALE: NTS	QUOTE NO.	PROJECT NO.	
DRAWN BY: JUM	DATE: 7-21-98	SHEET	DRAWING NO.
CHECKED BY: JUM	DATE: 7-21-98	1 OF 1	PF-3-C

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY TO POLLUTION CONTROL SYSTEMS AND IS NOT TO BE USED WITHOUT PERMISSION OF POLLUTION CONTROL SYSTEMS

REV.	DATE	DESCRIPTION	APPROV.
		UPDATED FOR UNDERCELL DESIGN CHANGE/ EXT. -B-	