
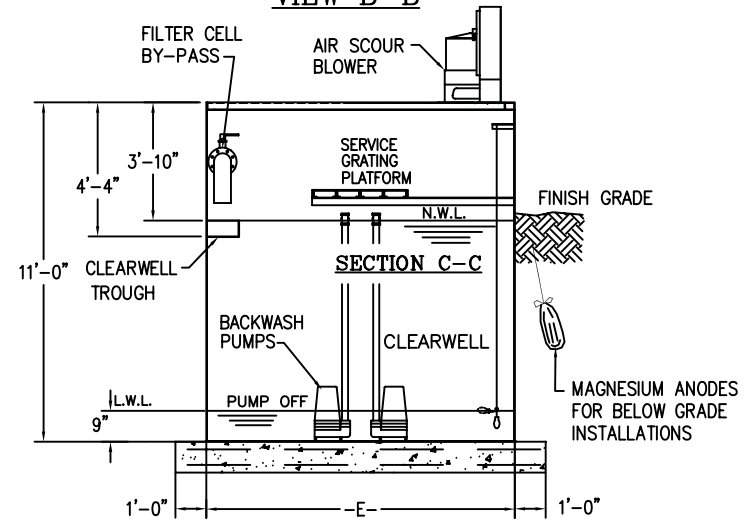
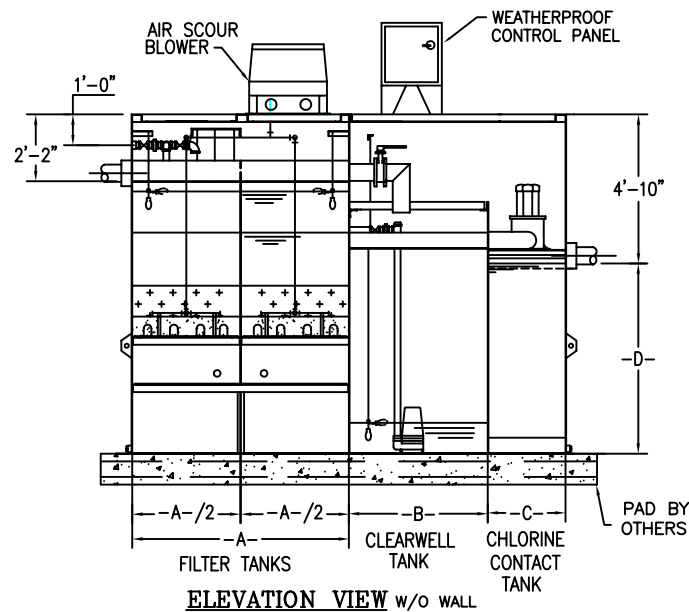
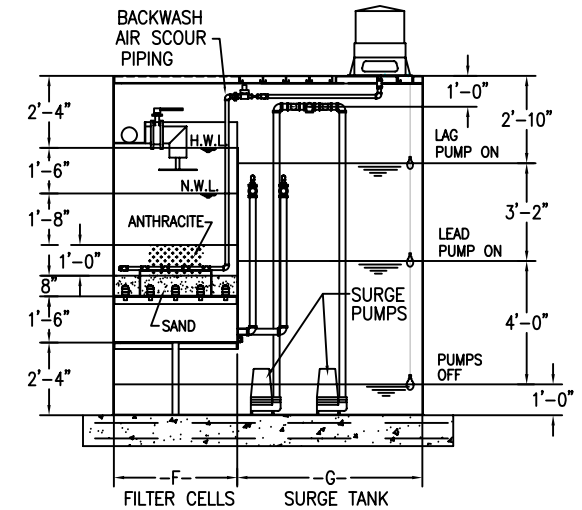


NOTES:

- 1.) ALL EXTERNAL TANK PIPING IS NOT SUPPLIED BY PCS
- 2.) ACCESS LADDERS AND HANDRAILS ARE OPTIONAL
- 3.) INCOMING ELECTRICAL POWER SUPPLY AND THE CONNECTION TO THE CONTROL PANEL IS BY OTHERS.
- 4.) FOUNDATION PAD DESIGN IS DETERMINED BY THE PROJECT ENGINEER AFTER PROJECT SITE SOIL ANALYSIS IS COMPLETED

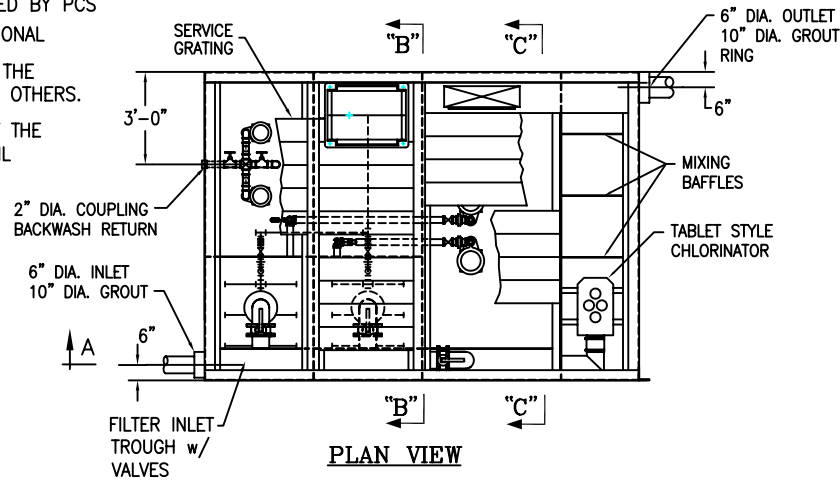

OPTIONAL EQUIPMENT- MATERIALS -TANKAGE	
FULL TANK GRATING	GALVANIZED PIPING
BAR TYPE GRATING	DE-CHLORINATION
HANDRAILS/ TOEPLATES	GAS CHLORINATION
LADDERS/ STAIRWAYS	U V DISINFECTION
ANCHOR BRK'TS	NEMA 4X PANEL
MAGNESIUM ANODES	REMOTE MOUNTED BLOWERS & CONTROLS
EPOXY PAINT SYSTEM	

TERTIARY FILTER MODEL NO.	AREA IN SQ. FT.		CHAMBER VOLUME IN GAL.		
	FILTER CELL NO. 1	FILTER CELL NO. 2	CLEARWELL	SURGE	CHLORINE CONTACT
TF-2- -C					

REV.	DATE	DESCRIPTION	APPROV.
1	11/29/84	UPDATED BLOWERS AND ADDED INLET-BYPASS VALVES	OM

PCS Pollution Control Systems, Inc.
 5827 Happy Hollow Ln, Suite 1B
 Millford, Ohio 45150
 (513) 831-1165
 E-mail: PolConSys@aol.com

PREFABRICATED TERTIARY FILTER SYSTEM			
SCALE:	NTS	QUOTE NO.	PROJECT NO.
DRAWN BY:	JJM	DATE:	7-21-98
CHECKED BY:	JJM	DATE:	7-21-98
SHEET	1 OF 1	DRAWING NO.	PF-3-C

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY TO POLLUTION CONTROL SYSTEMS AND IS NOT TO BE USED WITHOUT PERMISSION OF POLLUTION CONTROL SYSTEMS