




PLAN VIEW

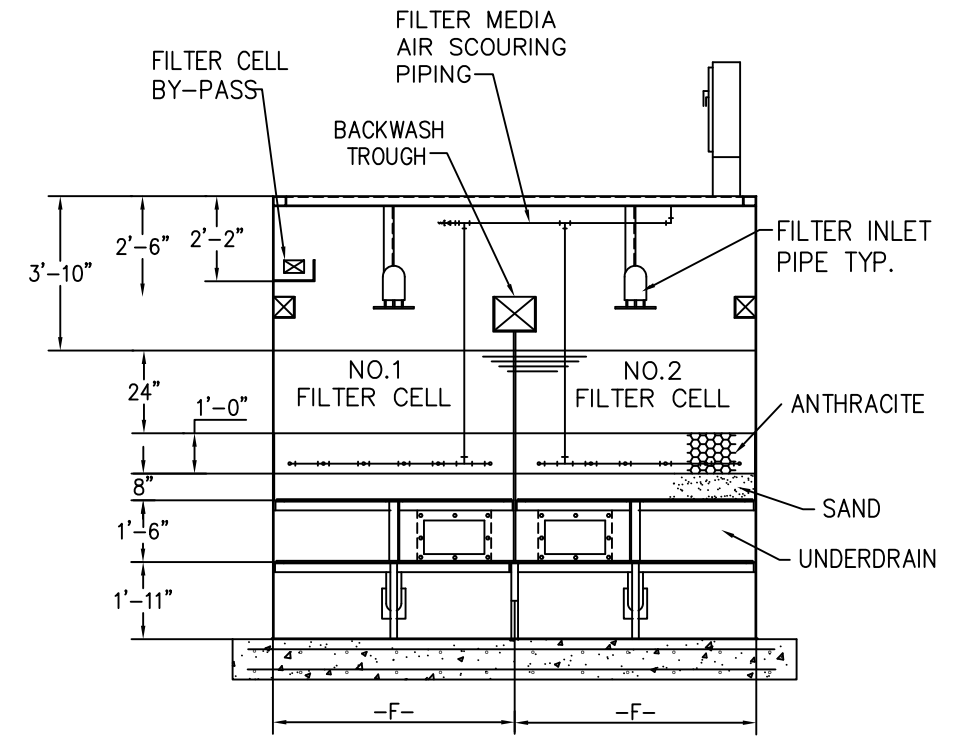

SECTION B-B

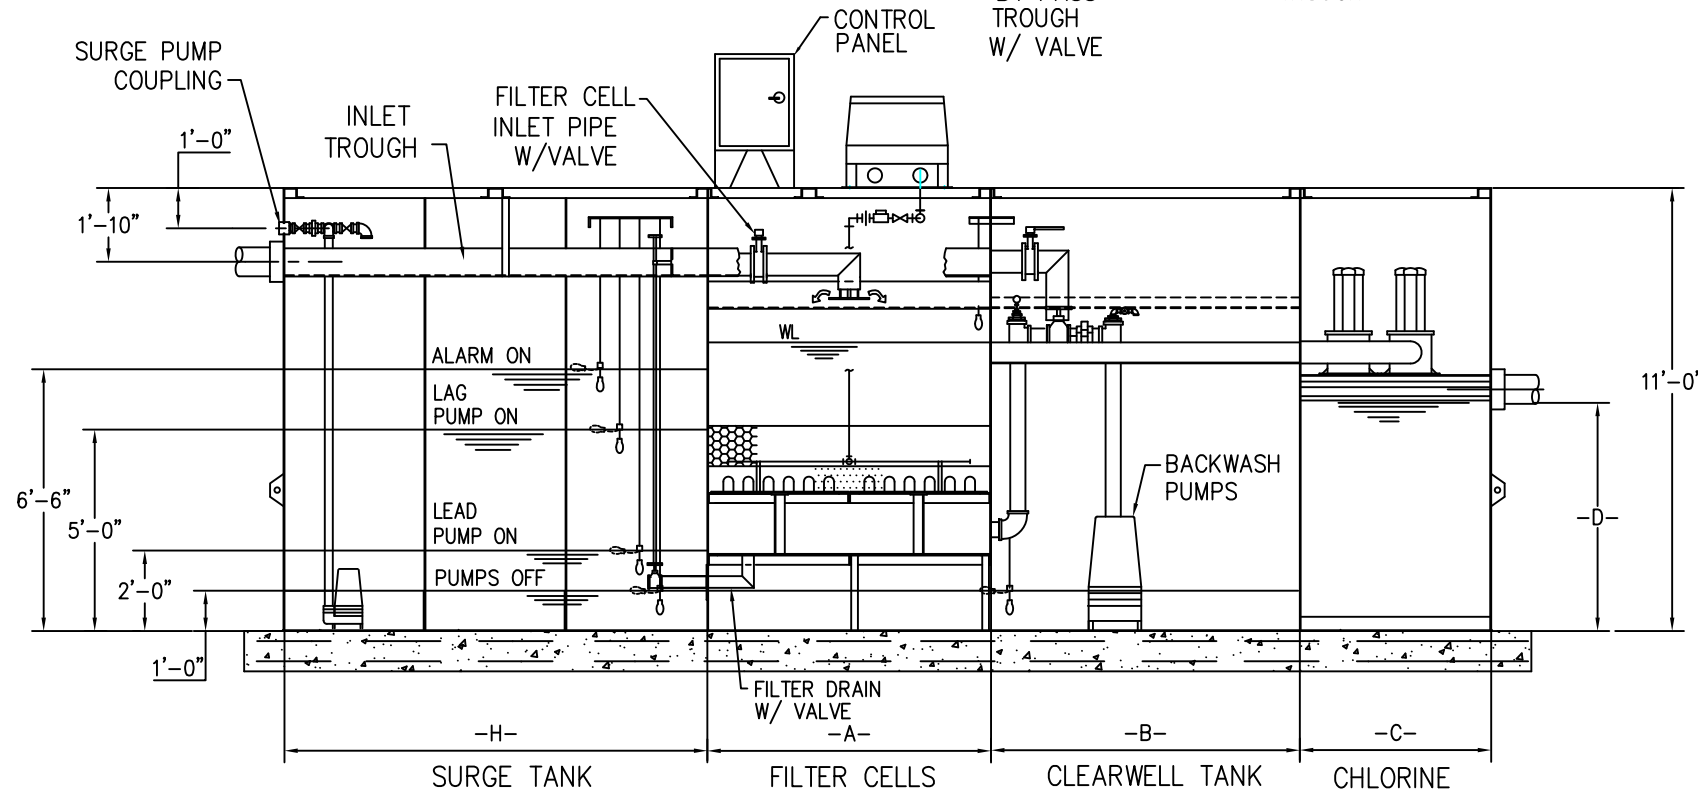

ELEVATION VIEW
W/O SIDE WALL

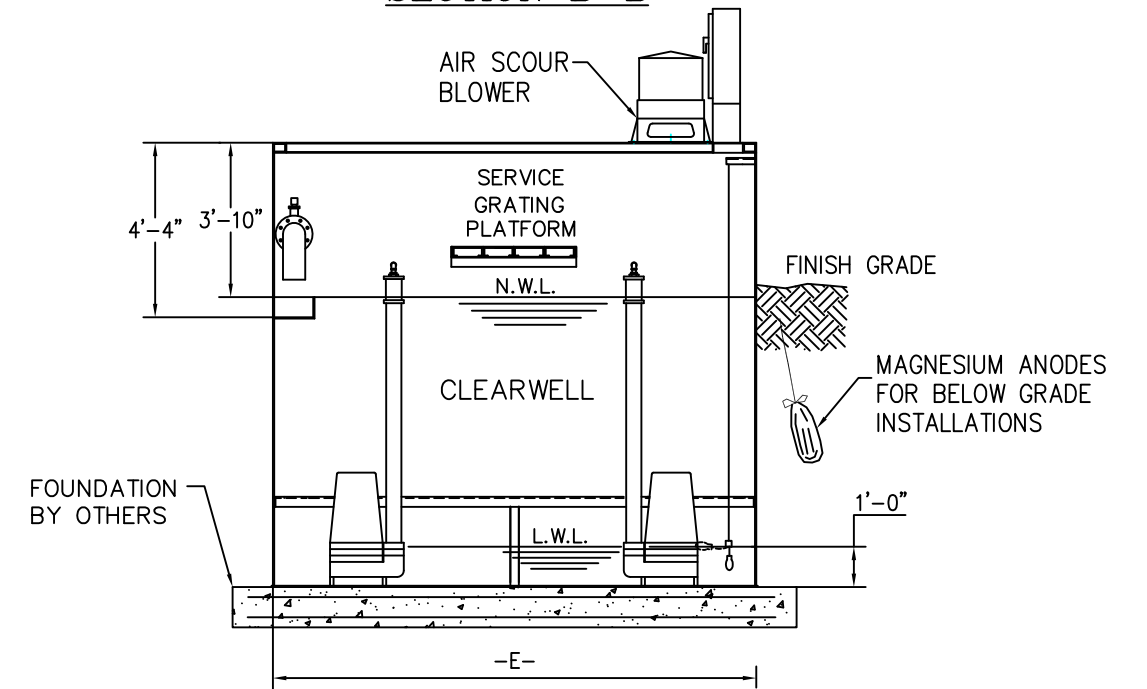

SECTION C-C

NOTES:

- 1) ALL EXTERNAL TANK PIPING IS NOT SUPPLIED BY PCS
- 2) ACCESS LADDERS AND HANDRAILS ARE OPTIONAL
- 3) INCOMING ELECTRICAL POWER SUPPLY AND THE CONNECTION TO THE CONTROL PANEL IS BY OTHERS.
- 4.) FOUNDATION PAD DESIGN IS DETERMINED BY THE PROJECT ENGINEER AFTER PROJECT SITE SOIL ANALYSIS IS COMPLETED

OPTIONAL
EQUIPMENT- MATERIALS -TANKAGE

FULL TANK GRATING	GALVANIZED PIPING
BAR TYPE GRATING	DE-CHLORINATION
HANDRAILS/ TOEPLATES	GAS CHLORINATION
LADDERS/ STAIRWAYS	U V DISINFECTION
ANCHOR BRK'TS	NEMA 4X PANEL
MAGNESIUM ANODES	REMOTE MOUNTED
EPOXY PAINT SYSTEM	BLOWERS & CONTROLS

TERTIARY FILTER MODEL NO.	AREA IN SQ. FT.		CHAMBER VOLUME IN GAL.		
	FILTER CELL NO. 1	FILTER CELL NO. 2	CLEARWELL	SURGE	CHLORINE CONTACT
TF-2- -C					

REV.	DATE	DESCRIPTION	APPROV.
Δ	12/17/18	ADDED VALVES TO FILTER DRAINS	JJM
Δ	11/19/14	UPDATED BLOWERS AND ADDED INLET-BYPASS VALVES	CRM

PCS Pollution Control Systems, Inc.
 5827 Happy Hollow Rd, Suite 1B
 Milford, Ohio 45150
 (513) 831-1165
 PolConSys @ AOL.com

PREFABRICATED TERTIARY FILTER SYSTEM

SCALE: NTS	QUOTE NO.	PROJECT NO.
DRAWN BY: JJM	DATE: 1-27-99	SHEET DRAWING NO.
CHECKED BY: JJM	DATE: 1-29-99	1 OF 1 PF-5-C

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY TO POLLUTION CONTROL SYSTEMS AND IS NOT TO BE USED WITHOUT PERMISSION OF POLLUTION CONTROL SYSTEMS